

Owner/Developer is to open and close all ditches.

O/D is to furnish and install all conduit in ditch (3" - SCH 80).

O/D is to furnish and install all sweeps (3" Galv. - 24" Radius).

O/D is to furnish and install pull rope (1/4" or larger).


Notes:

If the ditch does not reach the required depth, conduit is to be covered with 6" of concrete.

If the ditch crosses another utility, PES is to be located in the lower position and 6" of concrete separation is required. The concrete is to extend 18" either side of the crossing.

No ditch can be covered until PES has performed an inspection and pulled a warning tape. (O/D is to install tape 12" below final grade.)

If multiple runs of secondary wire are needed, O/D is to use Spec #31.

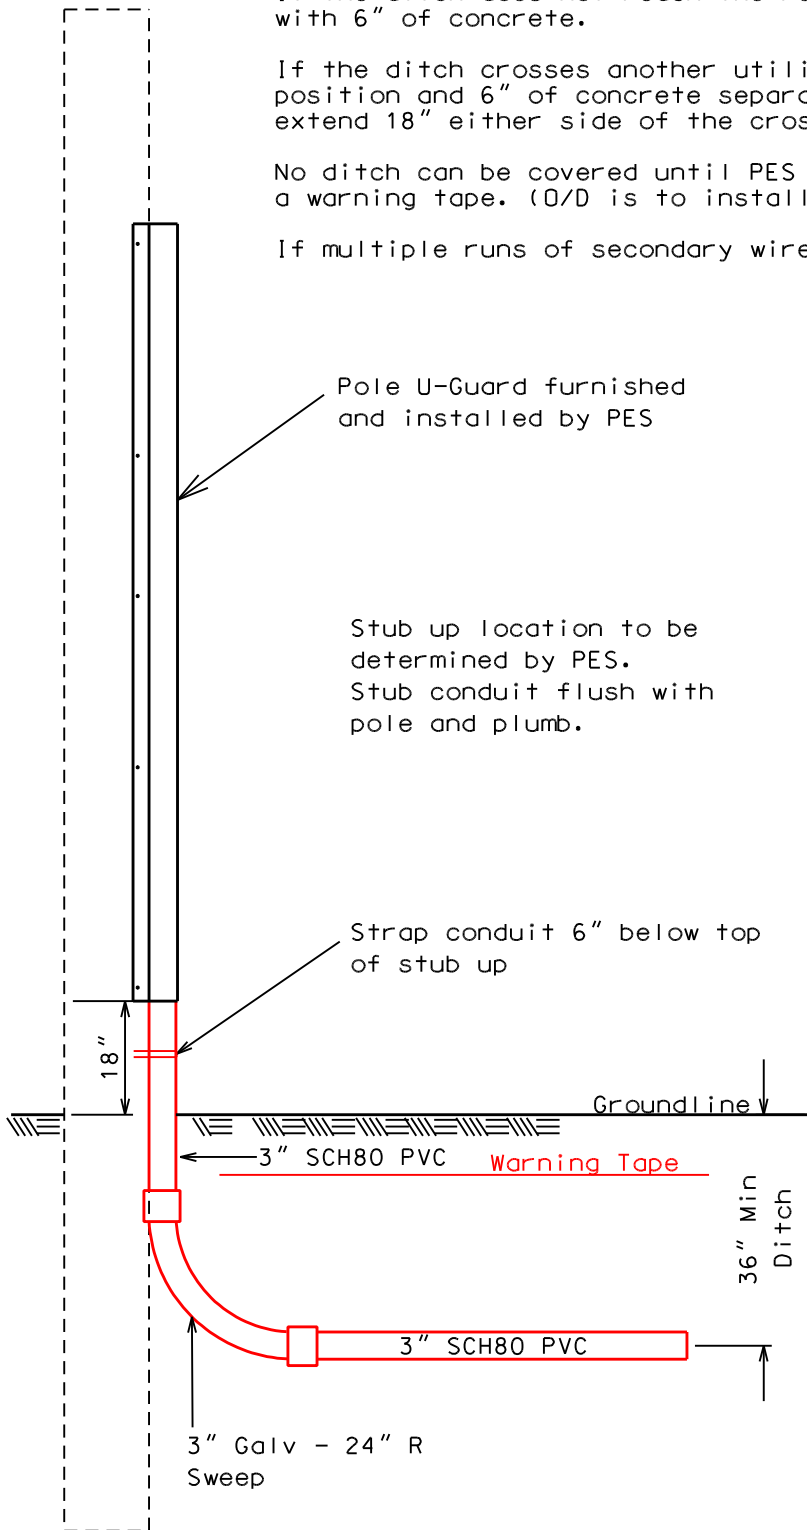

Pole U-Guard furnished and installed by PES

Stub up location to be determined by PES. Stub conduit flush with pole and plumb.

Strap conduit 6" below top of stub up

Groundline

3" SCH80 PVC Warning Tape

36" Min Ditch

3" SCH80 PVC

3" Galv - 24" R Sweep

Pulaski Electric System
Typical 3 Phase Secondary Duct & Riser
(This Spec is to be used for single runs only.)

revised March 2010